

COILING GRILLE—MODEL G42MA

08330/ATL
Buyline 0371

SPECIFICATIONS

PART 1 GENERAL

1.01 Section Includes

A. Type: Coiling Grilles are to be Atlas Door™ Model G42MA as manufactured by Clopay Building Products Company, Inc.

B. Operation: To be motor operated using high starting torque motor, limit switches for upper and lower limits of door travel, emergency hand chain with electrical interlock to break motor circuit when hand chain is engaged, magnetic relay contactor, overload protection, pre-wiring to terminal block and 3-button operating station. Motor is to be removable for repair without affecting emergency operation or limit switches. Manufacturer is to furnish wiring diagram.

NOTE: For additional motor operator components and controls refer to coiling motor operators tab.

C. Mounting: To be interior mounted between jambs in a prepared opening or "free standing" on structural tubes provided by Atlas Door.

1.02 Related Work

A. Opening preparation, miscellaneous or structural steel, access panels, finish or field painting, electrical wires, wiring, disconnect switches, conduit are in the scope of the work of other sections or trades.

B. Submit manufacturer's product data and installation instructions for each type of coiling door. Include both published data and any specific data prepared for this project.

1.03 Single-Source Responsibility

A. Provide doors, guides, motors, and accessories from one manufacturer for each type of door. Provide secondary components from source acceptable to manufacturer of primary components.

PART 2 PRODUCT

2.01 Curtain

A. Curtain: Is made from continuous horizontal cores spaced 2" (5.08 mm) on center, covered with aluminum spacer tubes and connected by aluminum vertical links.

B. Endlinks: To be furnished of a design to retain curtain in side guides.

C. Bottom Bar: Curtain to be reinforced with an extruded aluminum tube, reinforced for wider openings.

2.02 Spring Counterbalance

A. Counterbalance: Housed in a steel pipe of diameter and wall thickness to restrict maximum deflection to .03" per foot (2.5 mm/m) of grille width.

B. Springs: To be helical torsion type designed to include an overload factor of 25% and for optimum ease of operation. Springs are to be grease-packed and are to be mounted on a cold rolled steel inner shaft.

C. Emergency Hand Chain: Pull not to exceed 35 lbs. (156N).

D. Spring Tension: Adjustable from outside of end bracket plate.

E. Ball Bearing: Sealed, to minimize wear of pipe shaft rotation around inner shaft.

2.03 Bracket Plates

A. Bracket Plates: Carrying pipe counterbalancing shaft are to be no less than 1/4" (6.35 mm) thickness and to house ends of grille coil. Shape of plates to be square.

B. Drive End Bracket Plate: Fitted with a sealed ball bearing.

2.04 Guide and Wall Angle Assembly

A. Guides: To be extruded aluminum fitted with plastic insert for sound deadening and ease of operation.

B. Extrusion: To be designed to retain special end links of curtain.

C. Wall Angles: Structural steel angles of 3/8" (4.76 mm) minimum thickness.

2.05 Hoods

A. Hoods: Are not furnished on above ceiling installations since access to curtain and shaft is necessary. Provide access panels in ceiling at adjusting and operating sides.

2.06 Locking

A. Integral Gearing: Of motor operator to provide locking for grille.

2.07 Finish

A. Aluminum Surfaces: To have a mill finish.

B. Ungalvanized Surfaces: To consist of a shop coat of rust-inhibiting metallic primer on exposed ferrous surfaces, except bearings.

PART 3 EXECUTION

3.01 Examination

A. Verify that dimensions are correct and project conditions are suitable for installation. Do not proceed with installation until unsatisfactory conditions have been corrected.

3.02 Installation

A. Installation: To be by an authorized Atlas Door representative and in accordance with Atlas Door standards and instructions.

B. Submit manufacturer's product data and installation instructions for each type of coiling door. Include both published data and any specific data prepared for this project.

Note to Specifiers... Please see end of this section for frequently specified Optional Features.

Clear Opening Height	"D"	"E"	Clear Opening Width	"A"	"B"	"C"
to 5'-4 1/2" (1638 mm)	15" (381 mm)	2 1/2" (63.5 mm)	to 20'-0" (6096 mm)	7" (177.8 mm)	5 1/2" (139.7 mm)	3" (76.2 mm)
5'-4 1/2" to 8'-7 1/2" (1641 mm) (2626 mm)	16" (406 mm)	3" (76.2 mm)	20'-0" to 34'-0" (6099 mm) (10363 mm)	7" (177.8 mm)	6 1/2" (165.1 mm)	4" (101.6 mm)
8'-7 1/2" to 10'-5" (2638 mm) (3175 mm)	17" (432 mm)	3 1/2" (89.9 mm)	over 34'-0" (10363 mm)		Consult Technical Services	
10'-5 1/2" to 12'-3 1/2" (3178 mm) (3753 mm)	18" (457 mm)	4" (102 mm)				
12'-3 1/2" to 16'-4 1/2" (3756 mm) (4985 mm)	19" (483 mm)	4 1/2" (114 mm)				
over 16'-4 1/2" (4985 mm)	Consult Technical Services					

COILING GRILLE-MODEL G42*


08330/ATL
Buyline 0371

• Motor operated

• Interior between jamb mounted


*Suffix letters indicate material and/or finish of curtain.

MA Mill finish aluminum
AA Clear anodized aluminum
DA Bronze duranodic aluminum
ST Stainless steel
CV Clear-Vue plastic
DV Duranodic-Vue plastic

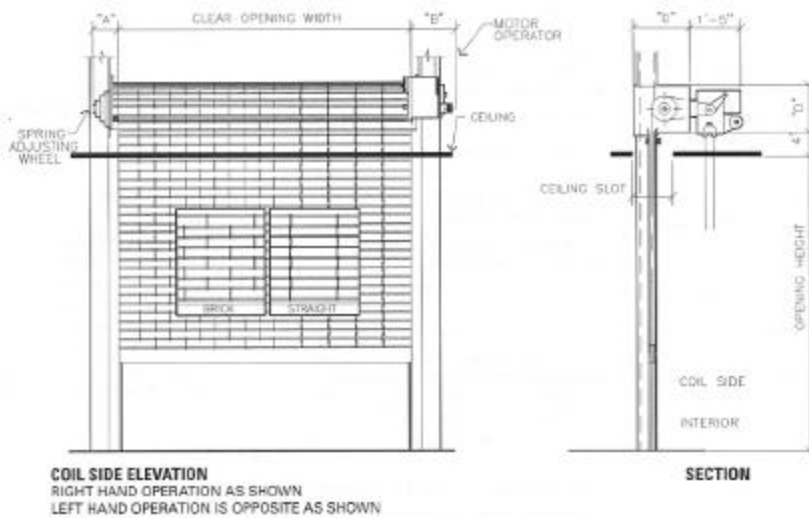

GUIDE DETAILS

Where clearances are critical, dimensions shown can be reduced. Consult Technical Services.

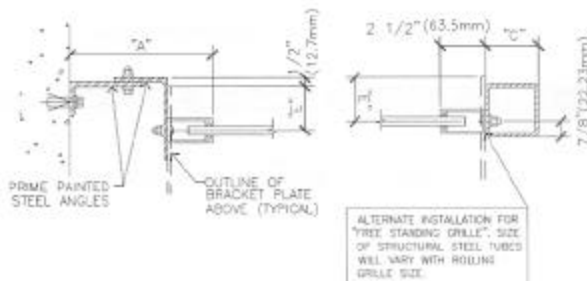

atlas door™